


KEYED JOINT SEE STANDARD DWG. 3-9.

NOTES

1. CURB RAMPS MUST BE INSTALLED WITHIN RETURN AREA. SEE STANDARD DWG. 3-17.
2. ALL APRONS SHALL BE CLASS "B" P.C.C. 7-1/2" THICK THROUGHOUT, OVER MIN. 2" OF 3/4" CLASS II A.B.
3. BROOM FINISH UNLESS OTHERWISE DIRECTED BY ENGINEER.
4. USE PIGMENTED SEALING COMPOUND FOR CURING.
5. CITY DISCOURAGES USE OF CROSS GUTTER AND STD. APRON. TO INSTALL CROSS GUTTER, SPECIAL APPROVAL FROM CITY ENGINEER IS REQUIRED.

0.06' FOR 6' GUTTER  
0.08' FOR 8' GUTTER

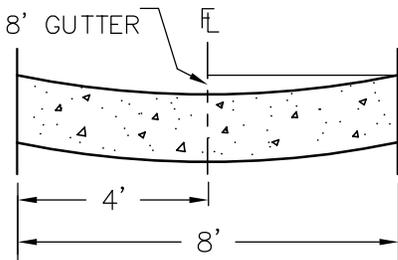

CROSS GUTTER PROFILES



**CITY OF VALLEJO STANDARD DETAIL**

**STANDARD APRON AND JOINT DETAILS**

APPROVED BY:

DIRECTOR OF PUBLIC WORKS

DRAWING NO:  
**3-07**

SCALE:  
NONE

DATE:  
**09/13/11**